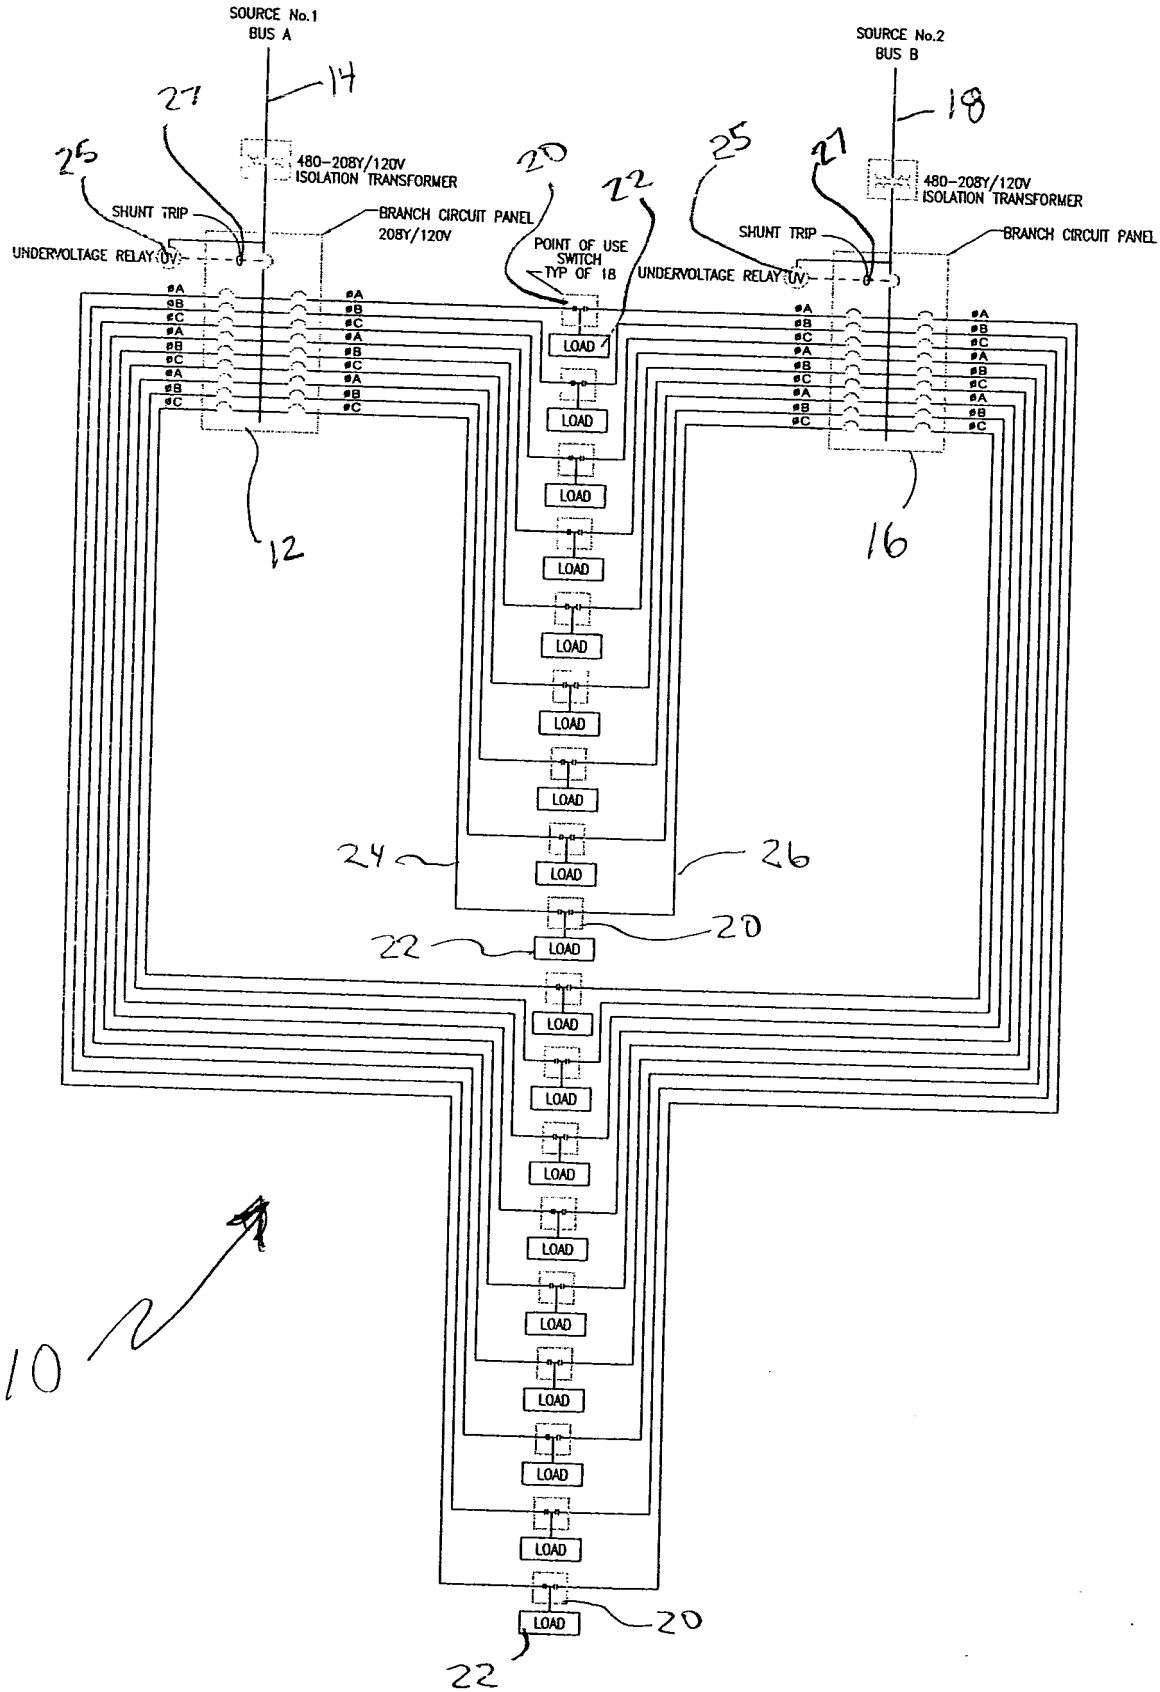
SOURCE No.1
BUS A
14
27
25
480-208Y/120V
ISOLATION TRANSFORMER
SHUNT TRIP
BRANCH CIRCUIT PANEL
208Y/120V
UNDERVOLTAGE RELAY UV
20
22
POINT OF USE
SWITCH
TYP OF 18
25
27
SOURCE No.2
BUS B
18
480-208Y/120V
ISOLATION TRANSFORMER
SHUNT TRIP
BRANCH CIRCUIT PANEL
UNDERVOLTAGE RELAY UV
ØA
ØB
ØC
LOAD
12
16
24
26
20
22
10
20
22